

Job Name/Location:**Tag No.:****Date:**

For:	File	Resubmit
	Approval	Other _____

PO No.:**Architect:****GC:****Engr:****Mech:****Rep:**

(Company)

(Project Manager)

KSSAL241A**R32 Single Zone Art Cool Premier Wall Mounted**

Outdoor Unit (ODU) - KUSAL241A, Indoor Unit (IDU) - KNSAL241A

Performance:**Cooling:**

Cooling Capacity (Min~Rated~Max, Btu/h)	3,070 ~ 22,000 ~ 30,000
SEER2	23.0
EER2	13.00

SEER - Seasonal Energy Efficiency Ratio

EER - Energy Efficiency Ratio

Heating:

Heating Capacity (Min~Rated~Max, Btu/h)	3,070 ~ 24,000 ~ 30,800
HSPF2	10.2
Max. Heating @ Indoor 70°F DB (Btu/h)	
Outdoor 19°F DB / 17°F WB	24,300
Outdoor 6°F DB / 5°F WB	21,600
Outdoor 1°F DB / 0°F WB	19,520
Outdoor -12°F DB / -13°F WB	14,780

HSPF - Heating Seasonal Performance Factor

Heating Nominal Test Conditions:

Cooling Nominal Test Conditions:

Indoor: 70°F DB / 60°F WB

Indoor: 80°F DB / 67°F WB

Outdoor: 47°F DB / 43°F WB

Outdoor: 95°F DB / 75°F WB

Electrical:

Power Supply (V/Hz/Ø)	208-230 / 60 / 1
MOP (A)	30
MCA (A)	19
Cooling / Heating Rated Amps (A)	14.8
Compressor (A)	14.4
Fan Motor (IDU + ODU) (A)	0.4
Cooling Power Input (Min~Rated~Max, kW)	0.40 ~ 1.69 ~ 3.17
Heating Power Input (Min~Rated~Max, kW)	0.66 ~ 1.92 ~ 3.24
Locked Rotor Amps (A)	17

MOP - Maximum Overcurrent Protection

MCA - Minimum Circuit Ampacity

Piping:

Liquid Line (in., O.D.)	3/8 Flare
Vapor Line (in., O.D.)	5/8 Flare
Additional Refrigerant (oz./ft.)	0.32
Min. / Max. Pipe Length (ft.) ²	9.8 / 164.0
Piping Length (no add'l refriger., ft.)	24.6
Max. Elevation (ft.)	98.4

Features:

- Inverter (Variable Speed Compressor)
- 24-Hour on/off timer
- 4-Way auto swing
- Sleep Mode
- Jet Cool/Jet Heat
- Auto Restart
- Auto Changeover
- Built-in Drain pan heater
- Built-in Wi-Fi via ThinQ app
- Smart Diagnosis
- Low ambient cooling down to 14°F (0°F with Wind Baffle Kit)
- Self-cleaning indoor coil

Included Accessories:

- Wireless Remote Controller — AKB76044208

Optional Accessories:

- ☐ PI-485 - PMNFP14A1
- ☐ Single-Port Shutoff Valve - PRHPZ010A
- ☐ Low Ambient Wind Baffle (Cooling to 0°F) - ZLABGP04A

Controller Options:

- ☐ MultiSITE™ CRC* Controllers
- ☐ Simple Remote Controllers
- ☐ Standard III Remote Controllers
- ☐ Remote Temp. Button Sensor
- ☐ Dry Contacts
- ☐ AC Smart 5 Central Controller
- ☐ LonWorks® Gateway
- ☐ MultiSITE Comm. Mgr.
- ☐ AC Smart BACnet® Gateway

**Operating Range:****Outdoor Unit:**

Cooling (°F DB)	14 ~ 118
Heating (°F WB)	-13 ~ +65

Indoor Unit:

Cooling (°F WB)	53 ~ 75
Heating (°F DB)	60 ~ 86

System Data:

Refrigerant Type	R32
Refrigerant Control	EEV
Refrigerant Charge (lbs.)	4.08
ODU Sound Pressure (Cooling / Heating) (±1 dB[A]) ³	55 / 56
IDU Sound Pressure	
Cooling (H/M/L/SL) (±1 dB[A]) ³	49 / 44 / 40 / 30
Heating (H/M/L) (±1 dB[A]) ³	49 / 44 / 40
ODU Net / Shipping Weight (lbs.)	135.4 / 147.7
IDU Net / Shipping Weight (lbs.)	37.7 / 45.6
Heat Exchanger Coating	GoldFin™

Fan:

ODU Type	Propeller
IDU Type	Cross Flow
Fan Speeds (Fan/Cool/Heat)	6 / 6 / 6
Quantity (ODU + IDU)	1 + 1
Motor/Drive	Brushless Digitally Controlled / Direct
Maximum ODU Air Volume (CFM)	2,119
IDU Air Flow	
Cooling, Max/H/M/L (CFM)	813 / 601 / 495 / 389
Heating, Max/H/M/L (CFM)	919 / 707 / 601 / 495
Dehumidification (pts./hr.)	4.65

Notes:

1. Acceptable operating voltage: 187V-253V.
2. Piping lengths are equivalent.
3. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
4. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 14 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes.
5. See Engineering Manual for sensible and latent capacities.
6. Power wiring cable size must comply with the applicable local and national code.
7. The indoor unit comes with a dry helium charge.
8. This data is rated 0 ft. above sea level, with 24.6 ft. of refrigerant line and a 0 ft. level difference between outdoor and indoor units.
9. Must follow installation instructions in the applicable LG installation manual.

BACnet® is a registered trademark of ASHRAE. LonWorks® is a trademark of Echelon Corporation.



Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps (excluding ductless systems) must be matched with appropriate coil components to meet ENERGY STAR® criteria. Ask your contractor for details or visit www.energystar.gov. (ENERGY STAR and the ENERGY STAR mark are registered trademarks owned by the U.S. Environmental Protection Agency.)

For a complete list of available accessories, contact your LG representative.

For continual product development, LG reserves the right to change specifications without notice.

© LG Electronics U.S.A., Inc., Englewood Cliffs, NJ. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lghvac.com

SB_SZ_Art_Cool_Premier_R32_KSSAL241A_2025_01_08_093716

Page 1 of 3

KSSAL241A

R32 Single Zone Art Cool Premier Wall Mounted


Outdoor Unit (ODU) - KUSAL241A, Indoor Unit (IDU) - KNSAL241A



Tag No.:

Date:

PO No.:

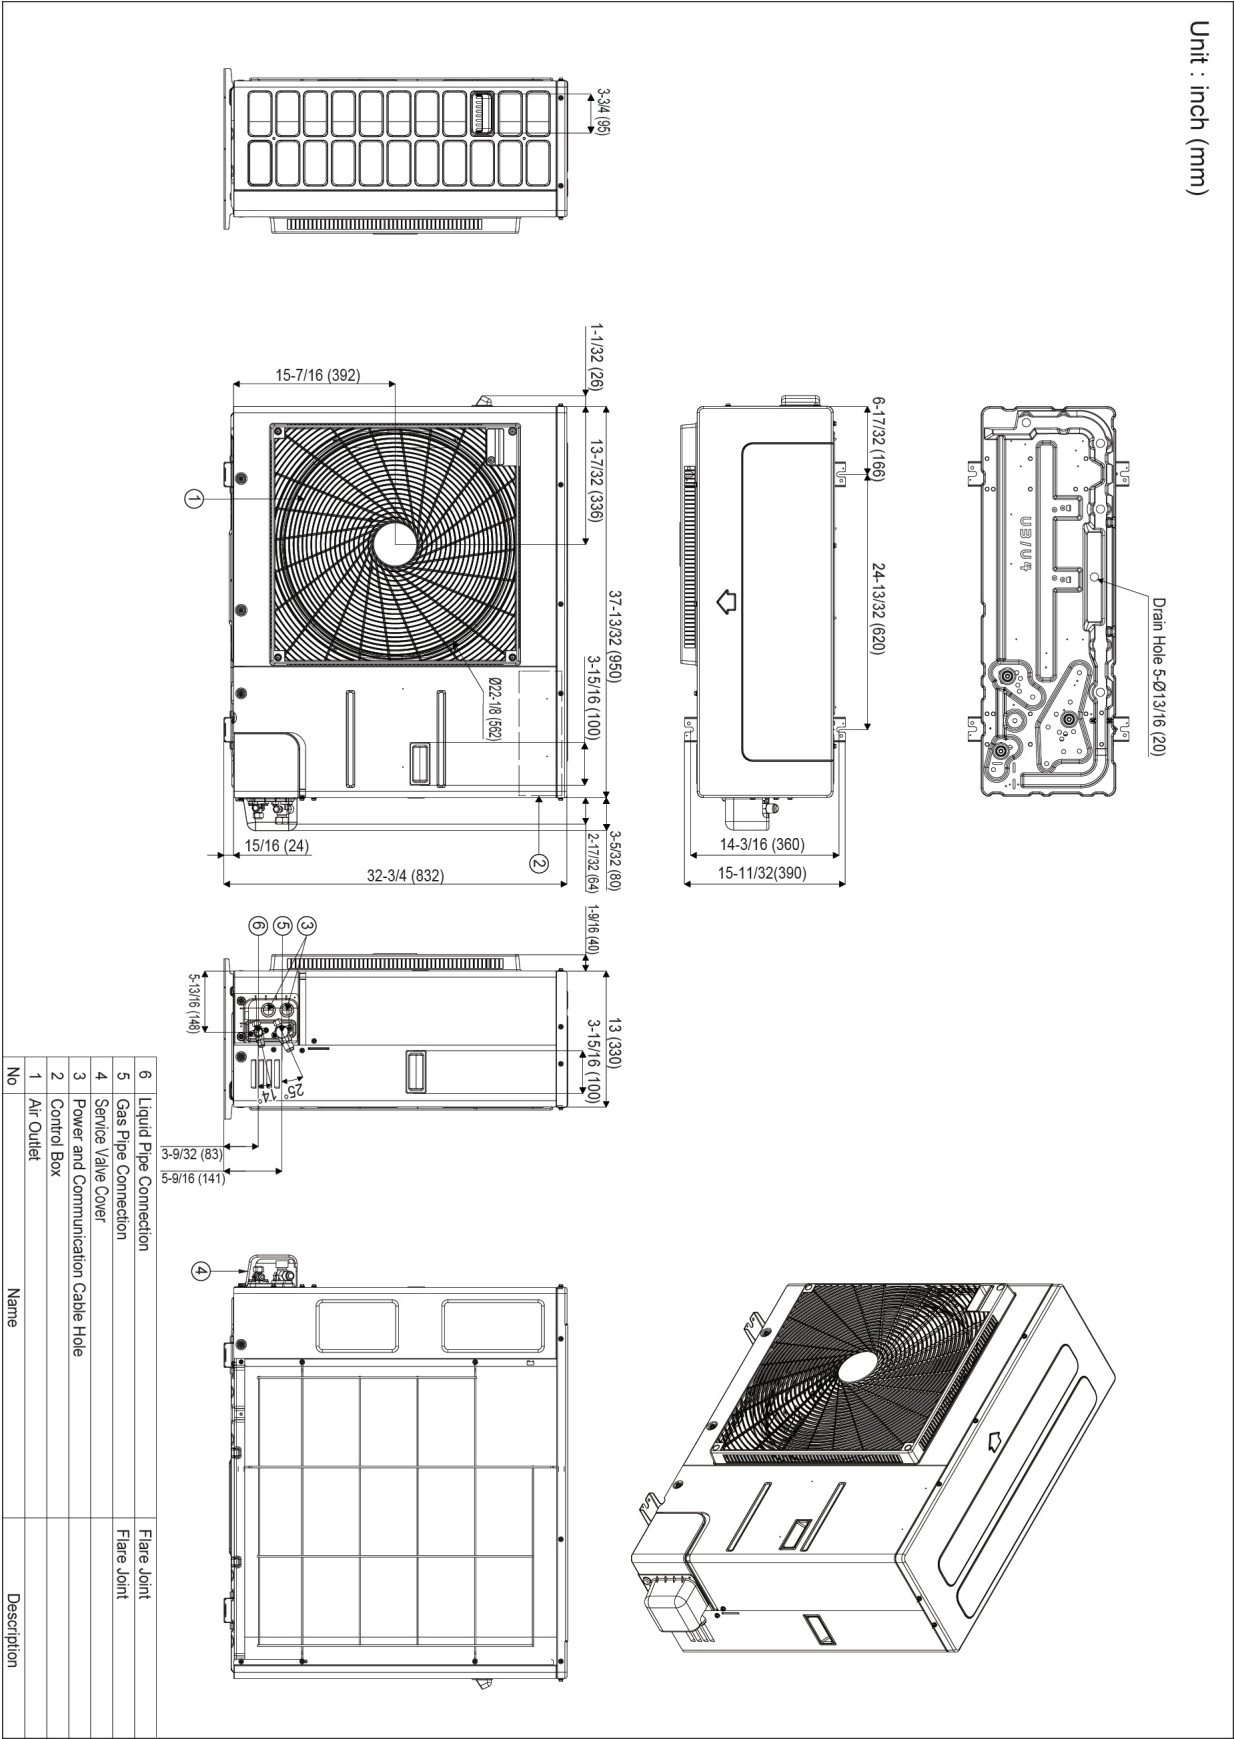

Job Name/Location: _____

KSSAL241A

R32 Single Zone Art Cool Premier Wall Mounted

Outdoor Unit (ODU) - KUSAL241A, Indoor Unit (IDU) - KNSAL241A



Tag No.: _____

Date: _____

PO No.: _____

