Job Name/Location: Tag No.: For: File Resubmit Date: Approval Other PO No .: GC: Architect:

Mech:



Engr: Rep:

(Project Manager)

KSUDA181A

R32 Single-Zone 2x2 Four-Way Ceiling Cassette with LGRED° Outdoor Unit (ODU) - KUSXA181A, Indoor Unit (IDU) -KNUDB181A

Operating Range:

Outdoor Unit: Cooling (°F DB)

Heating (°F WB) Indoor Unit:

Cooling (°F WB)

Heating (°F DB)



5~118 -13 ~ +64

57 ~ 77

59~81

Performance:

Cooling:

Cooling Capacity (Min~Rated~Max, Btu/h)	7,200~18,000~23,000
SEER2	20.5
EER2	13.2

EER - Energy Efficiency Ratio SEER - Seasonal Energy Efficiency Ratio

Heating:

Heating Capacity (Min~Rated~Max, Btu/h)	6,500~20,000~24,000
HSPF2	9.5
Max. Heating @ Indoor 70°F DB (Btu/h)	
Outdoor 17°F WB	22,500
Outdoor 5°F WB	20,000
Outdoor -4°F WB	17,900
Outdoor -13°F WB	15,500

HSPF - Heating Seasonal Performance Factor Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB Outdoor: 95°F DB / 75°F WB

Electrical:

Power Supply (V'/Hz/Ø)	208-230/60/1
MOP (A)	30
MCA (A)	19.1
Cooling / Heating Rated Amps (A)	15.85 / 15.85
Compressor (A)	14.0
Fan Motor (IDU + ODU) (A)	0.25 + 1.6
Cooling Power Input (Min~Rated~Max, kW)	0.50~1.37~2.80
Heating Power Input (Min~Rated~Max, kW)	0.46 ~1.73 ~ 2.6
Locked Rotor Amps (A)	11.5

MOP - Maximum Overcurrent Protection MCA - Minimum Circuit Ampacity

Piping:

<u> </u>	
Installed Liquid Pipe (in., O.D.)	3/8 Flare
Installed Vapor Pipe (in., O.D.)	5/8 Flare
IDU Liquid Connection (in., O.D.)	3/8 Flare
IDU Vapor Connection (in., O.D.)	5/8 Flare
Additional Refrigerant (oz./ft.)	0.38
Min. / Max. Pipe Length (ft.) ²	16.4 / 164
Piping Length (no add'l refrig., ft.)	24.6
Max. Elevation (ft.)	98.4

Features:

- Inverter (Variable Speed Compressor)
- Internal Condensate Pump
- Swirl Wind
- Jet Cool
- Auto Restart
- **Auto Changeover**
- Drain pan heater
- Ultra-quiet Turbo Fan
- Night Quiet Function
- · Optional Wi-Fi Control
- IDU compatible with
- Multi F ODUs

Included Accessories:

Wireless Remote Controller - PQWRHQ0FDB

Required Accessories:

☐ Grille Kit - PT-QAGW0

Optional Accessories:

- □ Ventilation Flange PTVK430
- ☐ Auxiliary Heater Kit
- □ Wi-Fi Module PWFMDD200
- □ Drain Pan Heater PQSH1200

Controller Options:

- ☐ MultiSITE™ CRC* Controllers
 ☐ Simple Remote Controller
- ☐ Standard III Remote Controllers
- □ Remote Temperature Button Sensor
- ☐ Low Ambient Wind Baffle (Cooling operation to -4°F) - ZLABGPO4A11
- □ Deluxe Remote Controller
- $\ \square$ Dry Contacts
- ☐ AHU Communication Kit

System Data:

Refrigerant Type	R32
Refrigerant Control	EEV
Refrigerant Charge (lbs.)	4.19
ODU Sound Pressure	
(Cooling / Heating) (±1 dB[A]) ³	51 / 52
IDU Sound Pressure	44 / 00 / 07
(H/M/L/SL) (±1 dB[A]) ³	41 / 39 / 36
ODU Net / Shipping Weight (lbs.)	141.8/ 160.1
IDU Net / Shipping Weight (lbs.)	30.9/37
Grille Net Weight (lbs.)	6.6 / 8.8
Heat Exchanger Coating	GoldFin™

Fan:

ODU Type	Propeller
IDU Type	Turbo
Fan Speeds (Fan/Cool/Heat)	4/5/4
Quantity (ODU + IDU)	1+1
Motor/Drive	Brushless Digitally Controlled/Direct
Maximum ODU Air Volume (CFM)	2.048
IDU Air Flow (CFM Max./H/M/L)	459 / 424 / 388
Dehumidification (pts./hr.)	3.1

- Acceptable operating voltage: 187V-253V.
- Piping lengths are equivalent.
- Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
 All power supply wiring to the outdoor unit is field supplied, solid or stranded. The power wiring and the communication wiring from the outdoor unit to the indoor unit is field supplied and must be stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only). All wiring
- must comply with applicable local and national codes.
 a. Power Supply Wiring to Outdoor Unit (No. x AWG): 3 x 12 for 9k, 12k, 18k, and 24k; 3 x 10 for 30k, 36k, 42k, and 48k.
- b. Power Wiring and Communication Wiring from Outdoor Unit to Indoor Unit (No. x AWG): 3 x 14 / 2 x 18.
 5. See Engineering Manual for sensible and latent capacities.

- This unit comes with a dry helium charge.
 This data is rated 0 ft. above sea level, with 24.6 ft. of refrigerant line and a 0 ft. level difference between
- 8. Must follow installation instructions in the applicable LG installation manual.
- 9. Multi compatible 18k IDUs include socket adapters for refrigerant pipe connections with Single Zone












KSUDA181A

R32 Single-Zone 2x2 Four-Way Ceiling Cassette with LGRED°
Outdoor Unit (ODU) - KUSXA181A, Indoor Unit (IDU) -KNUDB181A



Tag No.: ______
Date: _____

PO No.:

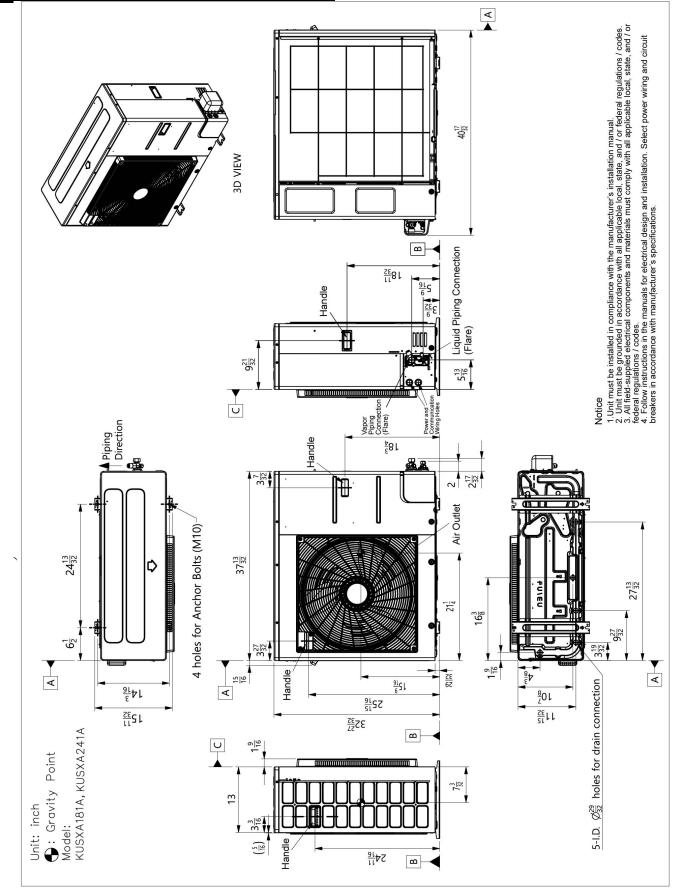

KSUDA181A

R32 Single-Zone 2x2 Four-Way Ceiling Cassette with LGRED° Outdoor Unit (ODU) - KUSXA181A, Indoor Unit (IDU) - KNUDB181A



Tag No.: ______

PO No.:

