

Job Name/Location:

Tag No.:

Date:

|      |          |            |
|------|----------|------------|
| For: | File     | Resubmit   |
|      | Approval | Other_____ |

PO No.:

Architect: GC:

Engr: Mech:

Rep: (Company) (Project Manager)

**KSUJA181A****Single Zone Mid Static Ducted LGRED°**

Outdoor Unit (ODU) - KUSXA181A, Indoor Unit (IDU) - KNUJB181A

**Performance:****Cooling:**

|                                         |                         |
|-----------------------------------------|-------------------------|
| Cooling Capacity (Min~Rated~Max, Btu/h) | 7,200 ~ 18,000 ~ 22,000 |
| SEER2                                   | 17.50                   |
| EER2                                    | 12.40                   |

SEER - Seasonal Energy Efficiency Ratio

EER - Energy Efficiency Ratio

**Heating:**

|                                         |                         |
|-----------------------------------------|-------------------------|
| Heating Capacity (Min~Rated~Max, Btu/h) | 6,800 ~ 20,000 ~ 24,000 |
| HSPF2                                   | 9.2                     |
| Max. Heating @ Indoor 70°F DB (Btu/h)   |                         |
| Outdoor 17°F WB                         | 22,200                  |
| Outdoor 5°F WB                          | 20,000                  |
| Outdoor -4°F WB                         | 17,500                  |
| Outdoor -13°F WB                        | 15,200                  |

HSPF - Heating Seasonal Performance Factor  
Cooling Nominal Test Conditions:  
Indoor: 80°F DB / 67°F WB  
Outdoor: 95°F DB / 75°F WB

Heating Nominal Test Conditions:  
Indoor: 70°F DB / 60°F WB  
Outdoor: 47°F DB / 43°F WB

**Electrical:**

|                                         |                    |
|-----------------------------------------|--------------------|
| Power Supply (V/Hz/Ø)                   | 208-230/60/1       |
| MOP (A)                                 | 30                 |
| MCA (A)                                 | 19.1               |
| Cooling / Heating Rated Amps (A)        | 17.3               |
| Compressor (A)                          | 14                 |
| Fan Motor (IDU + ODU) (A)               | 1.7 + 1.6          |
| Cooling Power Input (Min~Rated~Max, kW) | 0.50 ~ 1.45 ~ 2.80 |
| Heating Power Input (Min~Rated~Max, kW) | 0.50 ~ 1.58 ~ 2.54 |
| Locked Rotor Amps (A)                   | 11.5               |

MOP - Maximum Overcurrent Protection

MCA - Minimum Circuit Ampacity

**Piping:**

|                                            |            |
|--------------------------------------------|------------|
| Installed Liquid Pipe (in., O.D.)          | 3/8        |
| Installed Vapor Pipe (in., O.D.)           | 5/8        |
| IDU Liquid Connection (in., O.D.)          | 3/8        |
| IDU Vapor Connection (in., O.D.)           | 5/8        |
| Additional Refrigerant (oz./ft.)           | 0.38       |
| Min. / Max. Pipe Length (ft.) <sup>2</sup> | 16.4 / 164 |
| Piping Length (no add'l refrig., ft.)      | 24.6       |
| Max. Elevation (ft.)                       | 98.4       |

**Features:**

- Inverter (Variable Speed Compressor)
- Internal Condensate Pump
- Jet Cool / Jet Heat
- Auto Restart
- R32 Leak Detection Sensor
- Auto Changeover
- Night Quiet Operation
- Optional Wi-Fi Control
- Drain Pan Heater
- Direct / Indirect Wind
- Swirl Wind
- Smart Mode
- Refresh Mode
- Optional Aux Heater Relay Kit

**Optional Accessories:**

- ☐ PI-485 - PMNFP14A1
- ☐ Auxiliary Heater Kit - PRARH1
- ☐ Wi-Fi Module - PWFMD200
- ☐ Single Port Shutoff Valve - PRHPZ010A


**Controller Options:**

- ☐ MultiSITE™ CRC Controllers
- ☐ Simple Remote Controller
- ☐ Standard III Remote Controllers
- ☐ Remote Temperature Button Sensor
- ☐ Dry Contacts
- ☐ AC Smart 5 Central Controller
- ☐ LonWorks® Gateway
- ☐ MultiSITE Comm. Mgr.
- ☐ ACP 5 BACnet™ Gateway

For a complete list of available accessories, contact your LG representative.

For continual product development, LG reserves the right to change specifications without notice.

© LG Electronics U.S.A., Inc., Englewood Cliffs, NJ. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lgus.com

**Operating Range:****Outdoor Unit:**

|                 |           |
|-----------------|-----------|
| Cooling (°F DB) | 5 ~ 118   |
| Heating (°F WB) | -13 ~ +64 |

**Indoor Unit:**

|                 |         |
|-----------------|---------|
| Cooling (°F WB) | 57 ~ 77 |
| Heating (°F DB) | 59 ~ 81 |

**System Data:**

|                                                                |               |
|----------------------------------------------------------------|---------------|
| Refrigerant Type                                               | R32           |
| Refrigerant Control                                            | EEV           |
| Refrigerant Charge (lbs.)                                      | 4.19          |
| ODU Sound Pressure (Cooling / Heating) (±1 dB[A]) <sup>3</sup> | 51 / 52       |
| IDU Sound Pressure (H/M/L) (±1 dB[A]) <sup>3</sup>             | 36 / 32 / 29  |
| ODU Net / Shipping Weight (lbs.)                               | 141.8 / 160.1 |
| IDU Net / Shipping Weight (lbs.)                               | 61.5 / 71.7   |
| Heat Exchanger Coating                                         | GoldFin™      |

**Fan:**

|                                            |                                       |
|--------------------------------------------|---------------------------------------|
| ODU Type                                   | Propeller                             |
| IDU Type                                   | Sirocco                               |
| Fan Speeds (Fan/Cool/Heat)                 | 3 / 3 / 3                             |
| Quantity (ODU + IDU)                       | 1 + 1                                 |
| Motor/Drive                                | Brushless Digitally Controlled/Direct |
| Maximum ODU Air Volume (CFM)               | 2,048                                 |
| IDU Air Flow (CFM Max. H/M/L)              | 635.7 / 529.7 / 423.8                 |
| Default ESP (in wg)                        | 0.24                                  |
| Minimum ESP/Fan Setting Value <sup>4</sup> | 0.1 / 82                              |
| Maximum ESP/Fan Setting Value <sup>4</sup> | 0.59 / 156                            |
| Dehumidification (pts./hr.)                | 2.75                                  |

**Notes:**

- Acceptable operating voltage: 187V-253V.
- Piping lengths are equivalent.
- Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
- Maximum static pressure may result in reduced airflow (CFM).
- All power supply wiring to the outdoor unit is field supplied, solid or stranded. The power wiring and the communication wiring from the outdoor unit to the indoor unit is field supplied and must be stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only). All wiring must comply with applicable local and national codes.
  - Power Supply Wiring to ODU: (No. x AWG): 3 x 12 for 9k, 12k, 18k, and 24k; 3 x 10 for 30k, 36k, 42k, and 48k.
  - Power Wiring and Communication Wiring from Outdoor Unit to Indoor Unit: (No. x AWG) 3 x 14 / 2 x 18.
- See Engineering Manual for sensible and latent capacities.
- Power wiring cable size must comply with the applicable local and national code.
- The indoor unit comes with a dry helium charge.
- This data is rated 0 ft. above sea level, with 24.6 ft. of refrigerant line and a 0 ft. level difference between outdoor and indoor units.
- Must follow installation instructions in the applicable LG installation manual.
- If the optional low ambient wind baffle is used, one wind baffle is required for each ODU fan.

BACnet® is a registered trademark of ASHRAE. LonWorks® is a trademark of Echelon Corporation.

**LGRED°**

Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps (excluding ductless systems) must be matched with appropriate coil components to meet ENERGY STAR® criteria. Ask your contractor for details or visit [www.energystar.gov](http://www.energystar.gov). (ENERGY STAR and the ENERGY STAR mark are registered trademarks owned by the U.S. Environmental Protection Agency.)

SB\_SZ\_MidStatic\_Ducted\_LGRED\_R32\_KSUJA181A\_2024\_12\_20\_135127  
Page 1 of 3

KSUJA181A

Single Zone Mid Static Ducted LGRED°


Outdoor Unit (ODU) - KUSXA181A, Indoor Unit (IDU) - KNUJB181A



Tag No.: \_\_\_\_\_

Date: \_\_\_\_\_

PO No.: \_\_\_\_\_

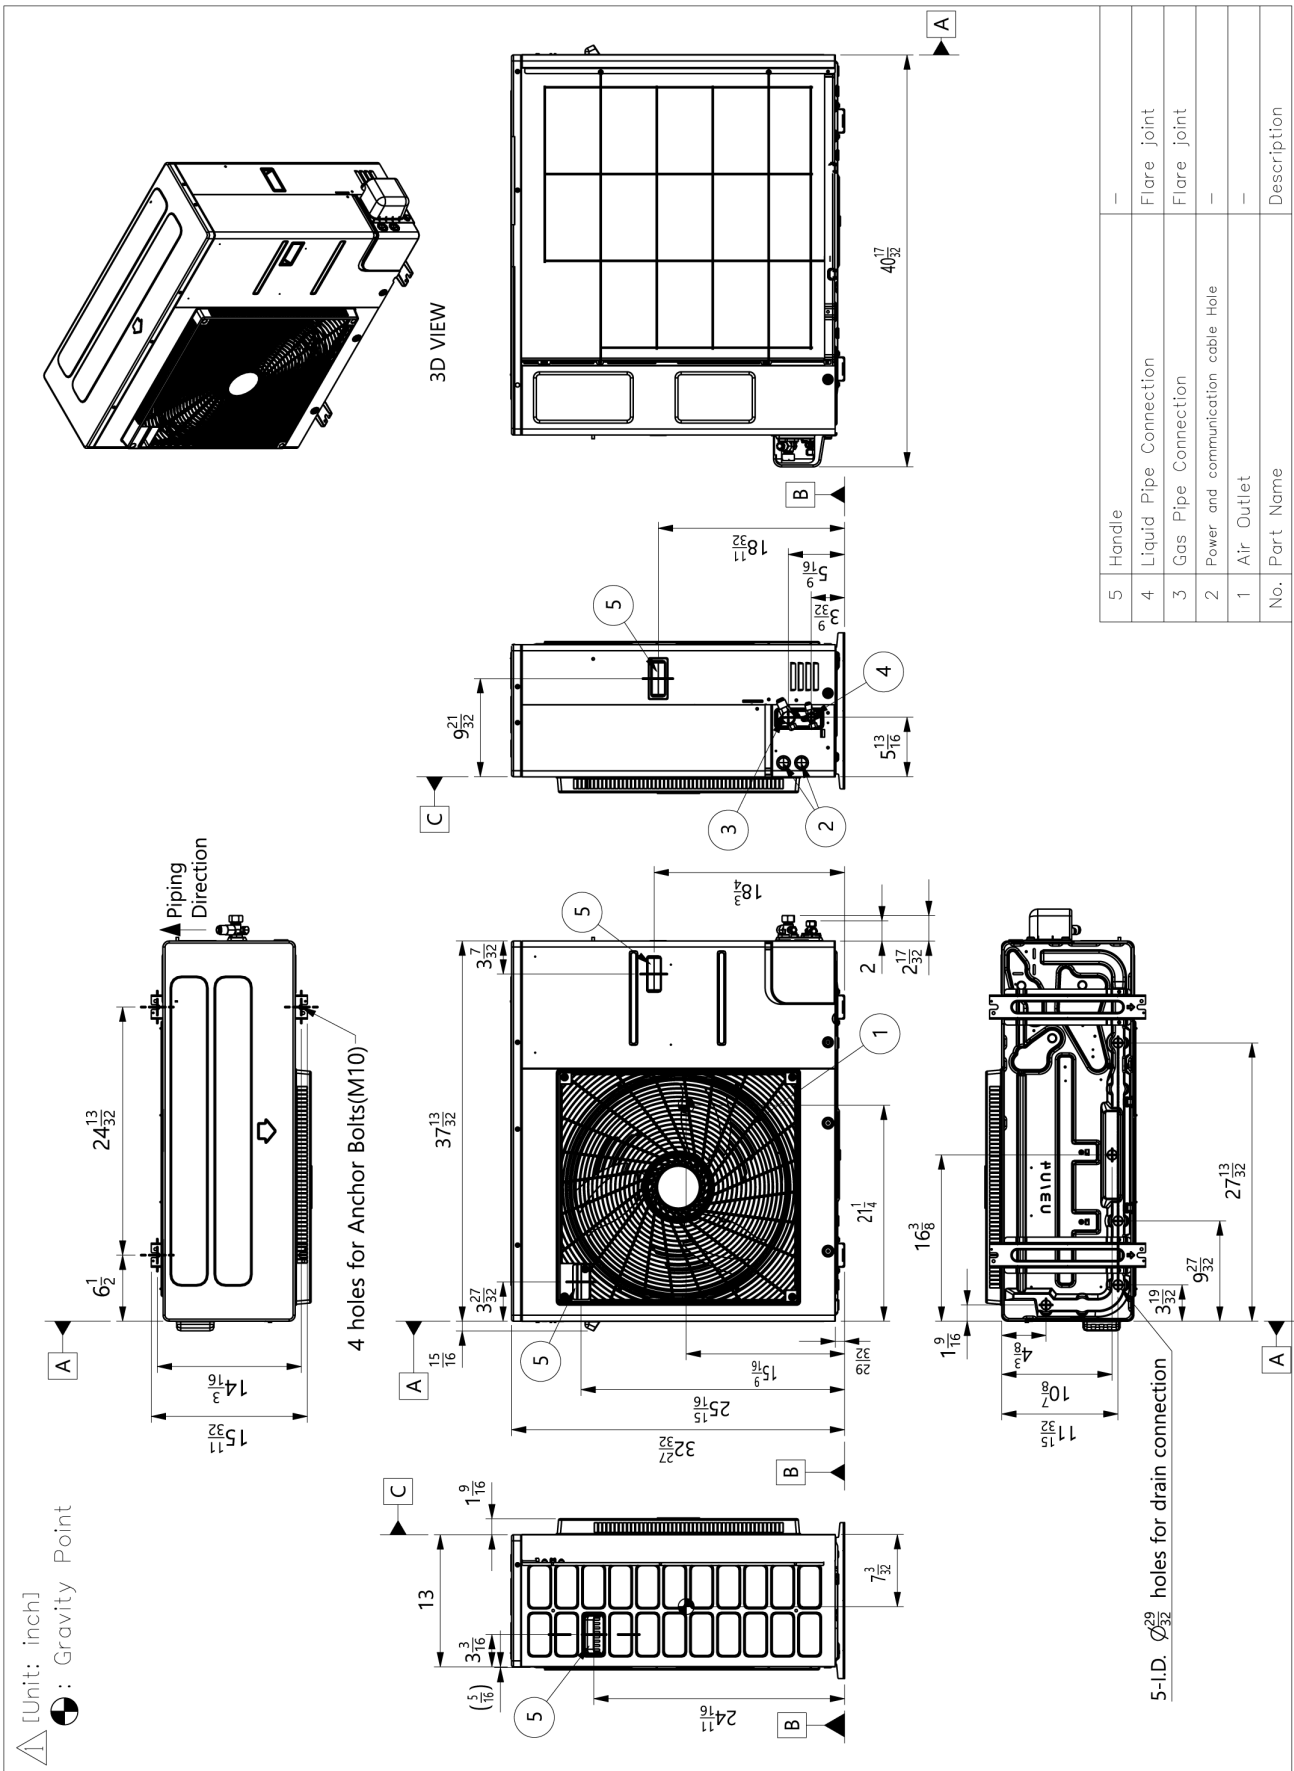


|     |                                    |             |   |
|-----|------------------------------------|-------------|---|
| 5   | Handle                             | —           | — |
| 4   | Liquid Pipe Connection             | Flare joint | — |
| 3   | Gas Pipe Connection                | Flare joint | — |
| 2   | Power and communication cable Hole | —           | — |
| 1   | Air Outlet                         | —           | — |
| No. | Part Name                          | Description |   |

**KSUJA181A**  
Single Zone Mid Static Ducted LGRED°  
Outdoor Unit (ODU) - KUSXA181A, Indoor Unit (IDU) - KNUJB181A



Tag No.: \_\_\_\_\_  
Date: \_\_\_\_\_  
PO No.: \_\_\_\_\_

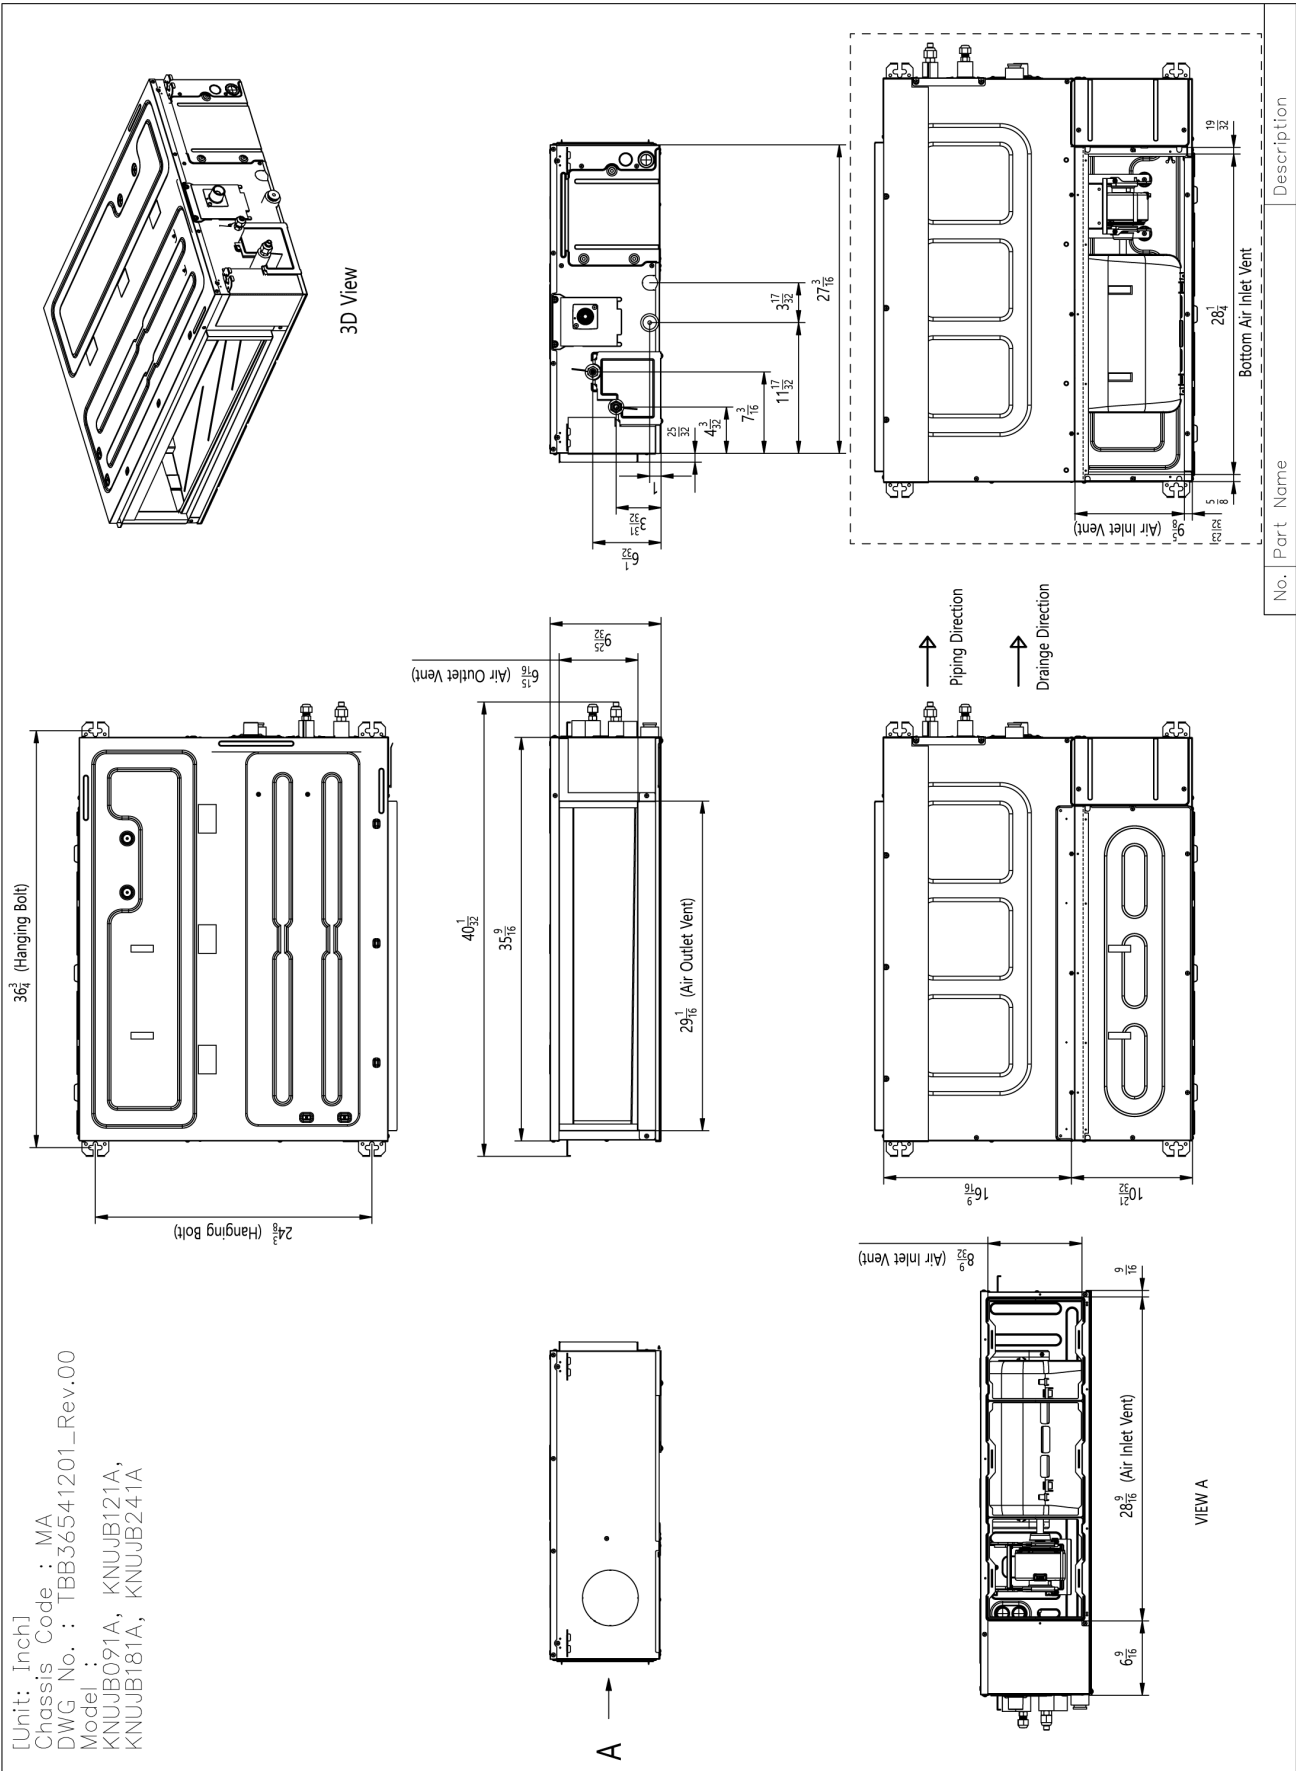

[Unit: Inch]  
Chassis Code : MA  
DWG No. : TBB36541201\_Rev.00  
Model : KNUJB091A, KNUJB121A,  
KNUJB181A, KNUJB241A