Job Name/Location: For: File Resubmit Date: **Approval** Other. PO No .: GC: Architect: Mech: Engr: Rep:

(Project Manager)





Tag No.:



KSSCA241A

R32 Single-Zone 3x3 Four-Way Ceiling Cassette with LGRED° Outdoor Unit (ODU) - KUSXA241A, Indoor Unit (IDU) -KNSCB241A

Performance:

Cooling:

	Cooling Capacity (Min~Rated~Max, Btu/h)	9,600~24,000~30,000
- 1	SEER2	22.0
	EER2	13.00

SEER - Seasonal Energy Efficiency Ratio EER - Energy Efficiency Ratio

Heating:

Heating Capacity (Min~Rated~Max, Btu/h) HSPF2	10,000~27,000~34,000 10.5
Max. Heating @ Indoor 70°F DB (Btu/h)	
Outdoor 17°F WB	29,700
Outdoor 5°F WB	28,000
Outdoor -4°F WB	24,800
Outdoor -13°F WB	21,600

LHSPF - Heating Seasonal Performance Factor Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB

Electrical:

Power Supply (V¹/Hz/Ø)	208-230/60/1
MOP (A)	30
MCA (A)	19.1
Cooling / Heating Rated Amps (A)	16.2 / 16.2
Compressor (A)	14.0
Fan Motor (IDU + ODU) (A)	0.6 + 1.6
Cooling Power Input (Min~Rated~Max, kW)	0.53~1.85~2.90
Heating Power Input (Min~Rated~Max, kW)	0.50~2.16~3.80
Locked Rotor Amps (A)	11.5

MOP - Maximum Overcurrent Protection

MCA - Minimum Circuit Ampacity

Piping:

Installed Liquid Pipe (in., O.D.)	3/8 Flare
Installed Vapor Pipe (in., O.D.)	5/8 Flare
IDU Liquid Connection (in., O.D.)	3/8 Flare
IDU Vapor Connection (in., O.D.)	5/8 Flare
Additional Refrigerant (oz./ft.)	0.38
Min. / Max. Pipe Length (ft.) ²	16.4 / 164
Piping Length (no add'l refrig., ft.)	24.6
Max. Elevation (ft.)	98.4

- Features:
 Inverter (Variable Speed Compressor)
- Internal Condensate Pump
- Jet Cool / Jet Heat Auto Restart
- Auto Changeover • Ultra-quiet Turbo Fan
- Night Quiet Function
- Optional Wi-Fi Control
- Drain Pan Heater
- Swirl Wind
- Direct / Indirect Wind
- Smart Mode
- Refresh Mode

Included Accessories: • Wireless Remote Controller - PWLSSB21H **Required Accessories:**

☐ Grille Kit - PT-AAGW0

Optional Accessories:

- ☐ Premium Panel (incl. Panel PT-AFGW0
- + Air Purif. Kit PTAHMP0)-PT-AFGW0S
- □ Decorative Cover-PTDCA □ Flange-PTVK430

- ☐ Auxillary Heater Kit-PRARH1
- □ Wi-Fi Module-PWFMDD200

☐ AC Smart 5 Central Controller

- ☐ Low Ambient Wind Baffle
- (Cooling operation to -4°F)-ZLABGP04A Require 1

Operating Range:

Outdoor Unit:

Cooling (°F DB)	5 ~ 118
Heating (°F WB)	-13 ~ +64

Indoor Unit:

Cooling (°F WB)	57 ~ 77
Heating (°F DB)	59 ~ 81

System Data:

Refrigerant Type Refrigerant Control	R32 EEV
Refrigerant Charge (lbs.)	4.19
ODU Sound Pressure	E4 / E0
(Cooling / Heating) (±1 dB[A]) ³	51 / 52
IDU Sound Pressure (H/M/L/SL) (±1 dB[A]) ³	40 / 37 / 35
ODU Net / Shipping Weight (lbs.)	141.8 / 160.1
IDU Net / Shipping Weight (lbs.)	45.9 / 56
Grille Net Weight (lbs.)	15.6 / 20.5
Heat Exchanger Coating	GoldFin™

Fan:

ODU Type	Propeller
IDU Type	Turbo
Fan Speeds (Fan/Cool/Heat)	4/5/5
Quantity (ODU + IDU)	1+1
Motor/Drive	Brushless Digitally Controlled/
	Direct
Maximum ODU Air Volume (CFM)	2.048
IDU Air Flow (CFM Max./H/M/L)	794 / 671 / 600 / 530
	4
Dehumidification (pts./hr.)	4

Notes:

- 1. Acceptable operating voltage: 187V-253V.
- 2. Piping lengths are equivalent.
- Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
- 4. All power supply wiring to the outdoor unit is field supplied, solid or stranded. The power wiring and the communication wiring from the outdoor unit to the indoor unit is field supplied and must be stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only). All wiring must comply with applicable local and national codes.
- a. Power Supply Wiring to Outdoor Unit (No. x AWG): 3 x 12 for 9k, 12k, 18k, and 24k; 3 x 10 for 30k, 36k, 42k, and 48k.
- b. Power Wiring and Communication Wiring from Outdoor Unit to Indoor Unit (No. x AWG): 3 x 14 / 2 x 18
- 5. See Engineering Manual for sensible and latent capacities.
- 6. This unit comes with a dry helium charge.
 7. This data is rated 0 ft. above sea level, with 24.6 ft. of refrigerant line and a 0 ft. level difference between outdoor and indoor units.
- 8. Must follow installation instructions in the applicable LG installation manual.
 9. If the optional low ambient wind baffle (ZLABGP04A) is used, one wind baffle is required for each ODU fan.

BACnet® is a registered trademark of ASHRAE. LonWorks® is a trademark of Echelon Corporation.











Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps (excluding ductless systems) must be matched with appropriate coil components to meet ENERGY STAR® criteria. Ask your contractor for details or visit www.energystar.gov. (ENERGY STAR and the ENERGY STAR mark are registered trademarks owned by the U.S. Environmental Protection Agency.)

Controller Options:

- □ MultiSITE™ CRC* Controllers ☐ Simple Remote Controller
- ☐ Standard III Remote Controllers
- ☐ Remote Temperature Button Sensors
- □ Dry Contacts

□ LonWorks® Gateway


□ MultiSITE Comm. Mgr.


□ ACP 5 BACnet Gateway

☐ AHU Communication Kit

KSSCA241A

R32 Single-Zone 3x3 Four-Way Ceiling Cassette with LGRED°
Outdoor Unit (ODU) - KUSXA241A, Indoor Unit (IDU) -KNSCB241A



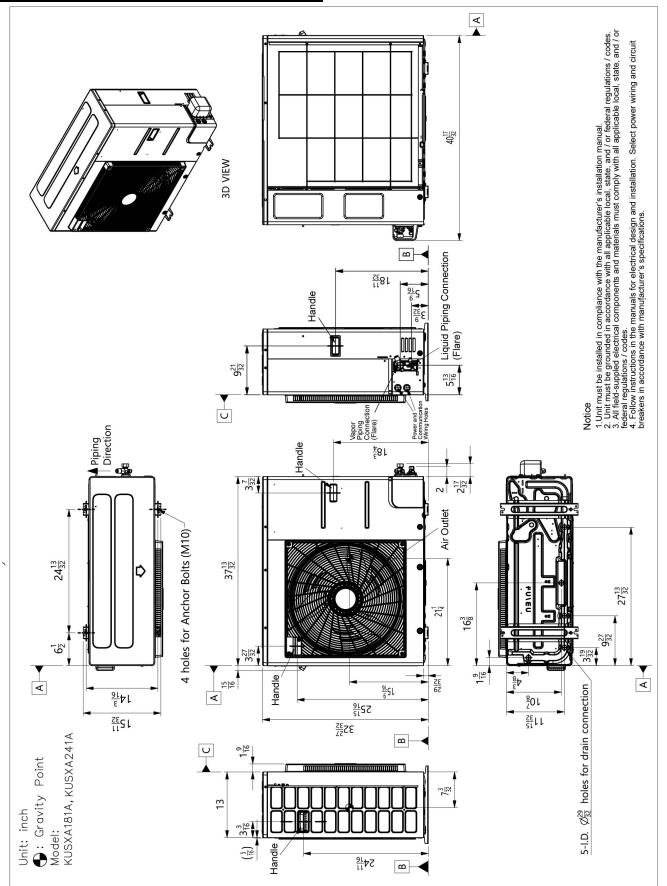

KSSCA241A

R32 Single-Zone 3x3 Four-Way Ceiling Cassette with LGRED° Outdoor Unit (ODU) - KUSXA241A, Indoor Unit (IDU) -KNSCB241A



